


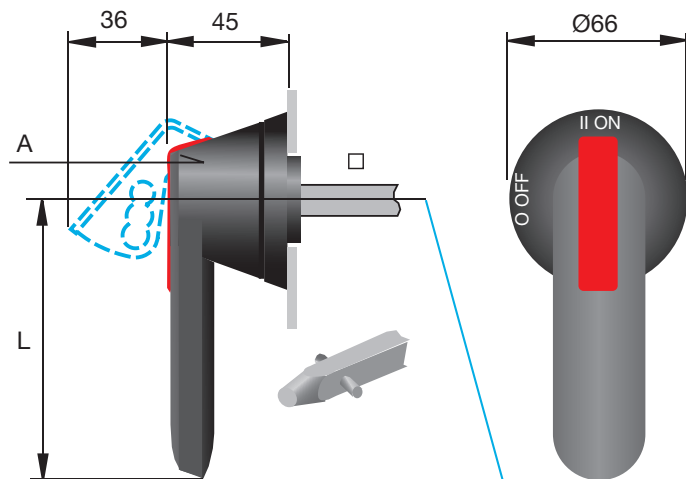

A	L	□
OHB 45J5	45	5
OHB 45J6	45	6
OHB 45J10	45	10
OHB 65J5	65	5
OHB 65J6	65	6
OHB 65J8	65	8
OHB 65J10	65	10
OHB 80J6	80	6
OHB 80J8	80	8
OHB 80J10	80	10
OHB 95J10	95	10
OHB 95J12	95	12
OHB 125J10	125	10
OHB 125J12	125	12
OHB 145J12	145	12
OHB 175J12	175	12
OHB 275J12	275	12

A00209A

J = IP65, UL/NEMA Type 1, 3R, 12
H = IP54, L = UL/NEMA Type 4, 4X

B = Y = G =

Protected by ABB Oy, Protection and Connection, Vaasa, Finland


34OH45-275S1 rev. R / 1SCC390009M0018

OH45-275S1 Installation instruction




Label should be affixed to the rear mounting surface immediately adjacent the handle after installation.


Type 1, 3R, 4, 4X or 12

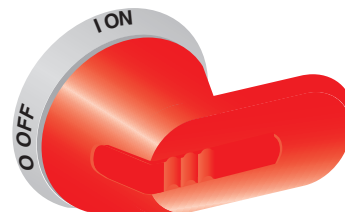

OHY 45...275_ _

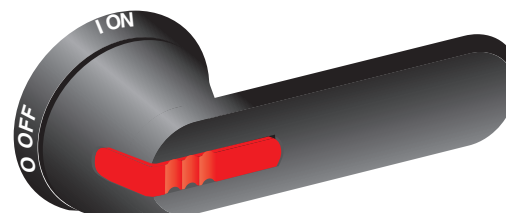

OHB 45...275_ _

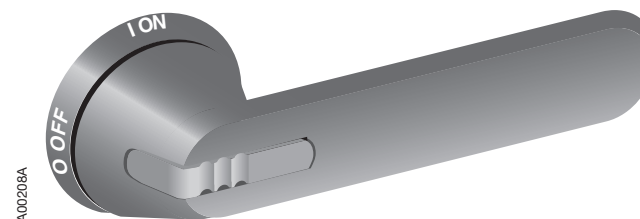

OHG 45...275_ _

A00208A

For more information please contact:

ABB Oy, Protection and Connection
P.O. Box 622, FI-65101 Vaasa, Finland
new.abb.com/low-voltage

Power and productivity
for a better world™



Power and productivity
for a better world™



