

Circuit-breaker, 3p, 80A

Part no. NZMH1-A80 Article no. 284412




Similar to illustration

Delivery program			
Product range			Circuit-breaker
Protective function			System and cable protection
Standard/Approval			IEC
nstallation type			Fixed
Release system			Thermomagnetic release
Construction size			NZM1
lumber of poles			3 pole
Standard equipment			Box terminal
Switching capacity			
400/415 V 50 Hz	I _{cu}	kA	100
Rated current = rated uninterrupted current			
Rated current = rated uninterrupted current	$I_n = I_u$	Α	80
Setting range			
Overload trip			
4	I _r	A	63 - 80
Short-circuit releases			
Non-delayed	$I_i = I_n x \dots$		6 - 10
Short-circuit releases	I _{rm}	A	480 - 800

Technical data

Conoral

General		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70
Operation	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140		
Between auxiliary contacts and main contacts	V AC	500
between the auxiliary contacts	V AC	300
Mounting position		Vertical and 90° in all directions



With residual-current release XFI: - NZM1, N1, NZM2, N2: vertical and 90° in all directions

with plug-in adapter elements
- NZM1, N1, NZM2, N2: vertical, 90° right/left

- with withdrawable unit: NZM3, N3: vertical, 90 ° left
- NZM4, N4: vertical
- with remote operator:
 NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions


Direction of incoming supply	as required
Degree of protection	
Device	In the operating controls area: IP20 (basic degree of protection)
Enclosures	With insulating surround: IP40 With door coupling rotary handle: IP66
Terminations	Tunnel terminal: IP10 Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)	Weight Temperature dependency, Derating Effective power loss
Circuit-hroakers	

Circuit-breakers


Rated current = rated uninterrupted current	$\boldsymbol{I}_n = \boldsymbol{I}_u$	Α	80
Rated surge voltage invariability	U_{imp}		
Main contacts		٧	6000
Auxiliary contacts		٧	6000
Rated operational voltage	U _e	V AC	690
Rated operational voltage	U _e	V DC	500
			Details apply for 3 pole system protection circuit-breaker with thermomagnetic release NZMN(H)1(2)(3)-A to 500 A.
			For rated operating voltage switching via 3 contacts:

DC correction factor for instantaneous release response value: NZM1: 1.25, NZM2:

Set value for I_i at DC = set value I_i AC/correction factor DC







Overvoltage category/pollution degree			III/3
Rated insulation voltage	U_{i}	V	690
Use in unearthed supply systems		V	≦ ₆₉₀

Switching capacity

I _{cm}		
I _{cm}	kA	220
I _{cm}	kA	220
I _{cm}	kA	74
I _{cm}	kA	40
Ic	kA	17
I _{cn}		
lcu	kA	
I _{cu}	kA	100
I _{cu}	kA	100
I _{cu}	kA	70
	I _{cm} I _{cm} I _{cm} I _{cm} I _c	I _{cm} kA I _{cm} kA I _{cm} kA I _{cm} kA Ic kA I _{cm} I _{cm} I _{cu} kA I _{cu} kA I _{cu} kA

1ct 1ct	eu eu es	kA kA kA kA kA kA	20 10 30 100 50 35 10 7.5
500 V DC Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0 240 V 50/60 Hz 400/415 V 50/60 Hz 440 V 50/60 Hz 1cs 525 V 50/60 Hz 1cs 690 V 50/60 Hz 1cs 1cs 1cs 1cs 1cs 1cs 1cs 1c	es e	kA kA kA kA kA	30 100 50 35 10 7.5
Ics to IEC/EN 60947 test cycle O-t-CO-t-CO	es s	kA kA kA kA kA	100 50 35 10 7.5
240 V 50/60 Hz	es es es es	kA kA kA kA	50 35 10 7.5
400/415 V 50/60 Hz	es es	kA kA kA	50 35 10 7.5
440 V 50/60 Hz	es es	kA kA kA	35 10 7.5
525 V 50/60 Hz	es	kA kA	10 7.5
690 V 50/60 Hz I _{CS} 500 V DC I _{CS} Utilization category to IEC/EN 60947-2	:s	kA	7.5
500 V DC I _{Cs} Utilization category to IEC/EN 60947-2			
Utilization category to IEC/EN 60947-2	ss	kA	30
			Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.
			A
nateu making and breaking capacity			A
Pated aparational current		A	
Rated operational current I _e	1	A	
AC-1			20
380 V 400 V I _e		Α .	80
415 V I _e			80
690 V I _e	1	Α	80
AC3			
380 V 400 V	•	Α	80
415 V		Α	80
660 V 690 V	1	Α	80
DC-1			
500 V DC		CSA	125
DC - 3			
500 V DC	1	CSA	125
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	perations		20000
Lifespan, electrical			
AC-1			
400 V 50/60 Hz	perations		10000
415 V 50/60 Hz	perations		10000
690 V 50/60 Hz	perations		7500
AC3			
400 V 50/60 Hz	perations		7500
415 V 50/60 Hz	perations		7500
690 V 50/60 Hz Op	perations		5000
DC-1			
500 V DC		Operation	90000
DC - 3			
500 V DC 0p	perations		5000
Max. operating frequency		Ops/h	120
Total downtime in a short-circuit		ms	< 10
Terminal capacity			
Standard equipment			Box terminal
Optional accessories			Screw connection Tunnel terminal
			connection on rear
Round copper conductor			
Box terminal			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (10 - 70) ³⁾
		ann	2 x (6-25)
			³⁾ Up to 95 mm² can be connected depending on the cable manufacturer.
Tunnel terminal			. •

Solid		mm ²	1 x 16
Stranded		mm^2	
Stranded		mm^2	1 x (25 - 95)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16) 2 x (10 - 16)
Stranded		mm ²	1 x (25 - 70) ³⁾ 2 x 25
			³⁾ Up to 95 mm² can be connected depending on the cable manufacturer.
Al conductors, Cu cable			
Solid		mm^2	1 x 16
Stranded		mm ²	
Stranded		mm ²	1 x (25 - 95)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	9×9×0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M6
Direct on the switch			
	min.	mm	12 x 5
	max.	mm	16 x 5
Control cables			
		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

Design verification as per IEC/EN 61439			
Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	80
Equipment heat dissipation, current-dependent	P_{vid}	W	16.32
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
$10.2.3.3\mbox{Verification}$ of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.

10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 6.0


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation prot. (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss8.1-27-37-04-09 [AJZ716010])

protection (ecl@ss8.1-27-37-04-09 [AJZ716010])		
Rated permanent current lu	Α	80
Rated voltage	V	690 - 690
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	100
Overload release current setting	А	63 - 80
Adjustment range short-term delayed short-circuit release	А	0 - 0
Adjustment range undelayed short-circuit release	А	480 - 800
Integrated earth fault protection		No
Type of electrical connection of main circuit		Frame clamp
Device construction		Built-in device fixed built-in technique
Suitable for DIN rail (top hat rail) mounting		No
DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as normally closed contact		0
Number of auxiliary contacts as normally open contact		0
Number of auxiliary contacts as change-over contact		0
Switched-off indicator available		No
With under voltage release		No
Number of poles		3
Position of connection for main current circuit		Front side
Type of control element		Rocker lever
Complete device with protection unit		Yes
Motor drive integrated		No
Motor drive optional		No
Degree of protection (IP)		IP20

Characteristics

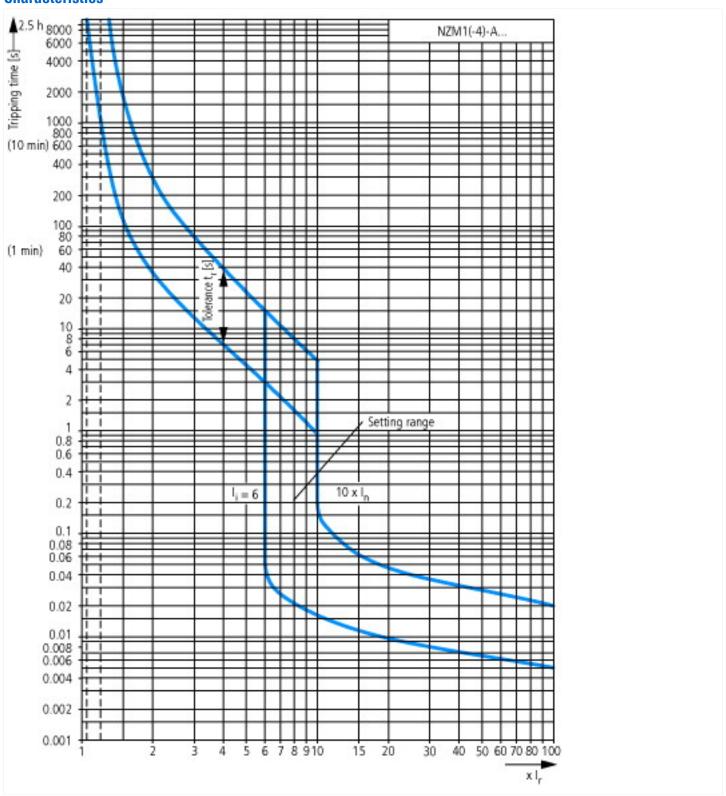

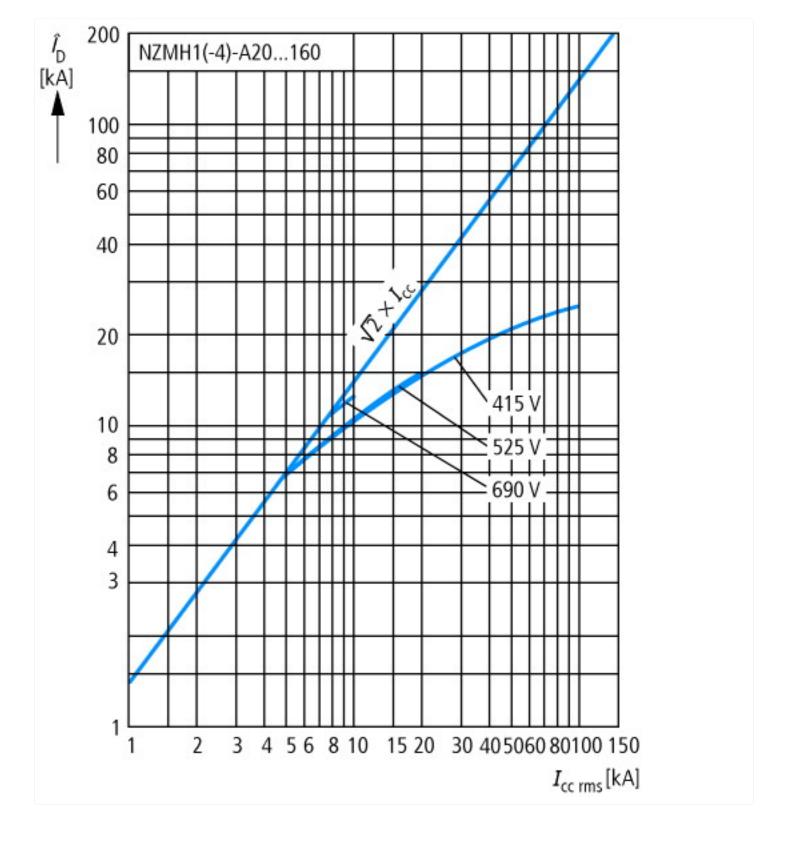

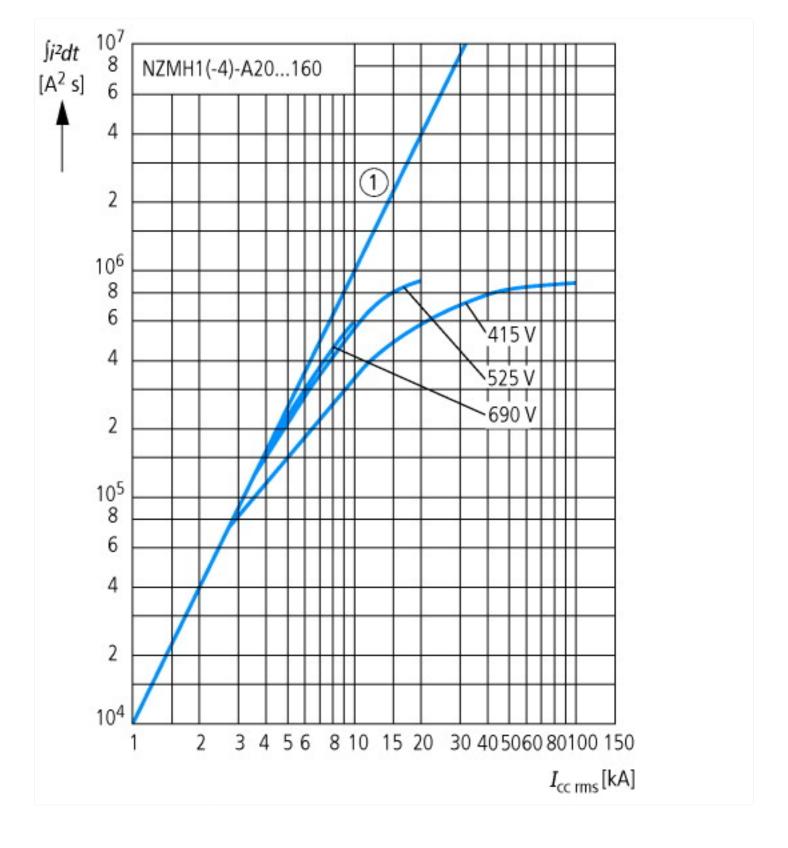


 $M4 \times 50/10$

44.6

SW4

(1) Blow out area, minimum clearance to adjacent parts

30

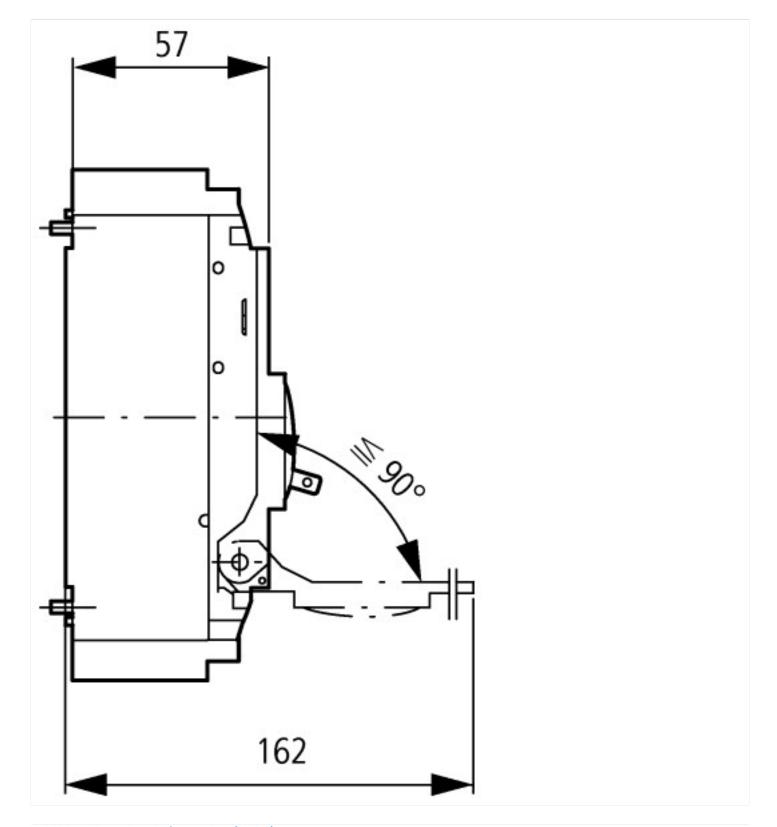

Additional product information (links)

IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector				
IL01203004Z (AWA1230-1913) Circuit-breaker, ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01203004Z2015_11.pdf Switch-Disconnector				
Weight	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.171			
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172			
Effective power loss	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.174			
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm			